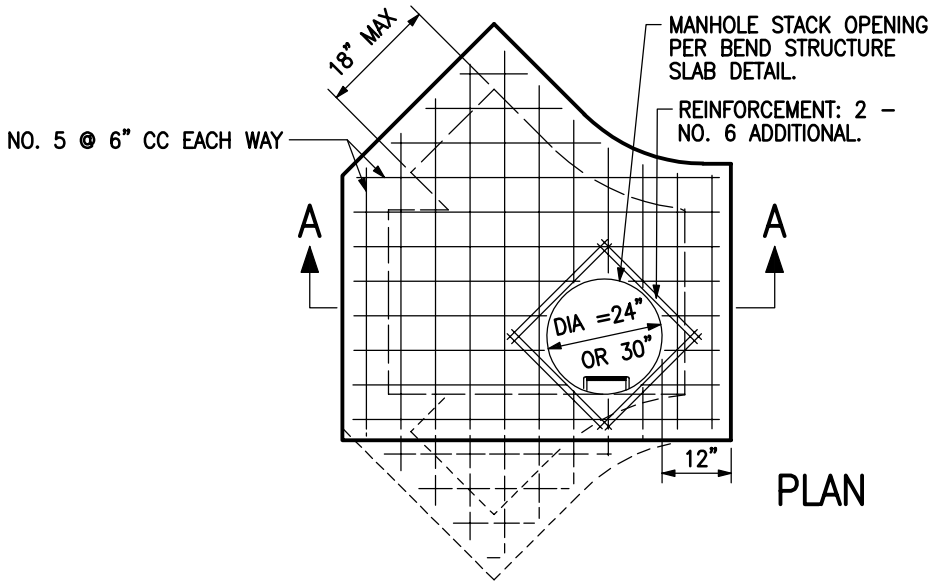

PLAN

MINIMUM DIMENSIONS		
D	A	B
15"–18"	3'–9"	2'–9"
21"–30"	4'–4"	3'–7"
33"–36"	4'–7"	3'–11"

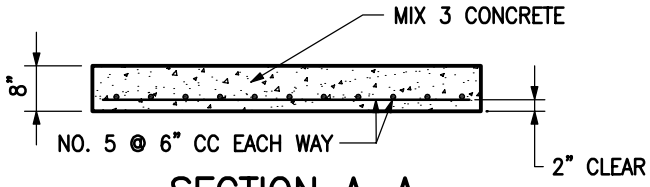

SECTION A–A
(ROOF SLAB REINFORCEMENT)

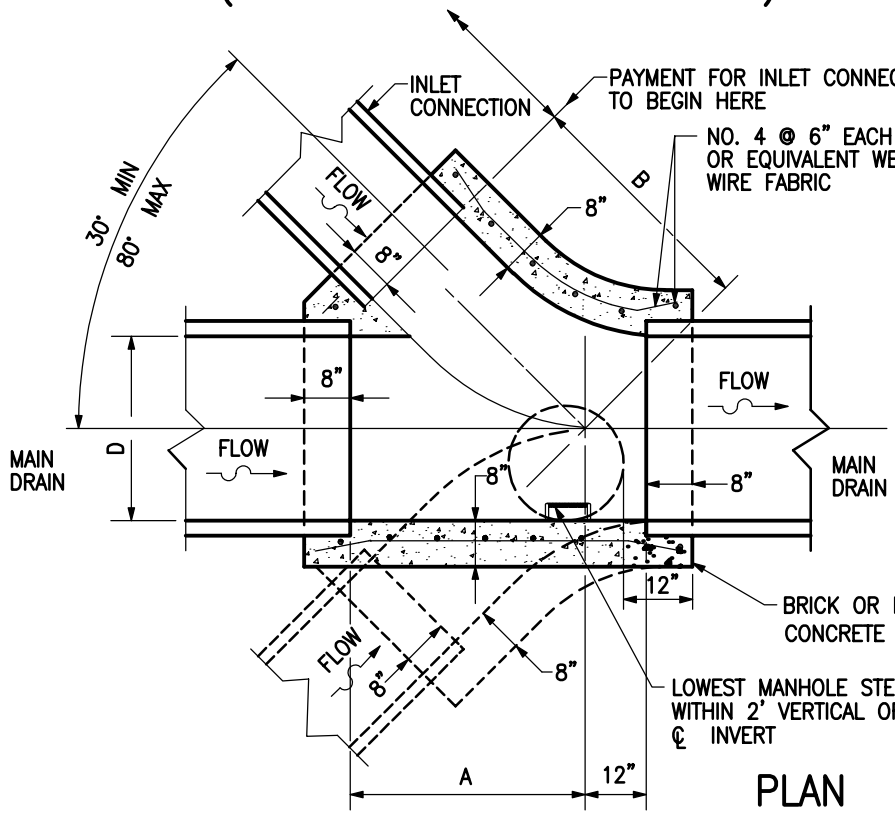

PLAN

NOTES:

1. WALLS AND BOTTOM SHALL BE BRICK OR MIX 3 REINFORCED CONCRETE. USE NO. 4 BARS AT 6" EACH WAY OR EQUIVALENT WELDED WIRE FABRIC.
2. SLAB OPENING FOR MANHOLE STACK IS 3' DIA EXCEPT WHERE FRAME INSTALLED WITHOUT PRECAST MANHOLE RISER.

APPROVED :

HEAD, BUREAU OF WATER AND WASTEWATER

DIRECTOR, DEPARTMENT OF PUBLIC WORKS

CITY OF BALTIMORE
DEPARTMENT OF PUBLIC WORKS
BUREAU OF WATER AND WASTEWATER

CONCRETE OR
BRICK 'Y'
SINGLE OR DOUBLE

ISSUED	REVISED	REVISED
3 / 2008		

STANDARD NO.
BC 318.02

SCALE : NONE

SHEET 1 OF 1