




SECTION D-D

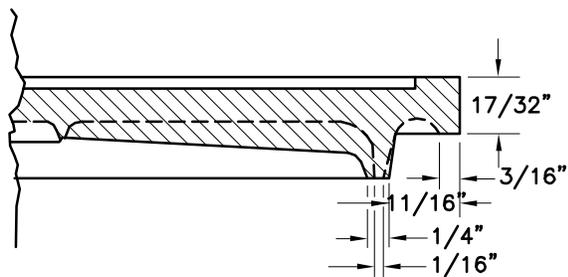


SECTION E-E

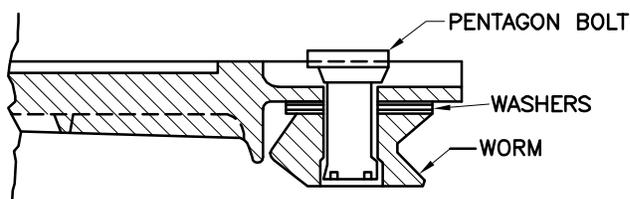



ASSEMBLED SECTION AT B-B

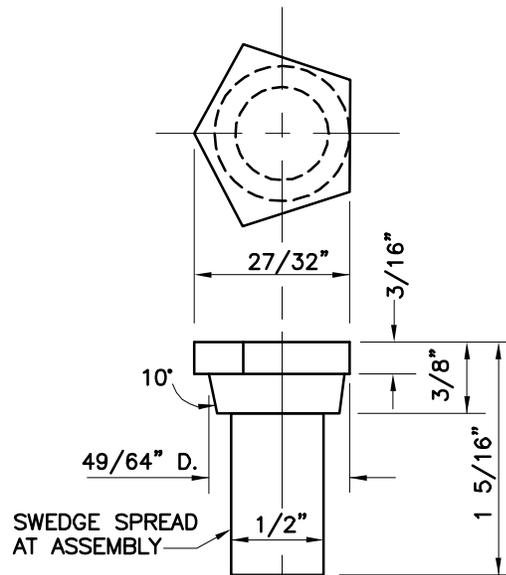

LOCKING BOLT
(SILICONE BRONZE-1 REQUIRED)

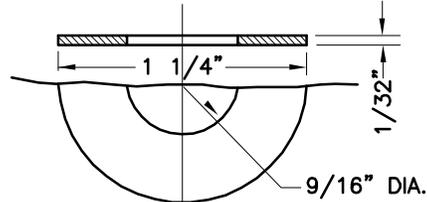

WASHERS (COPPER ALLOY - 1 REQUIRED)
(NYLON - 1 REQUIRED)

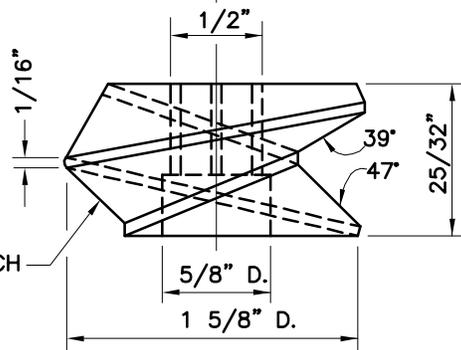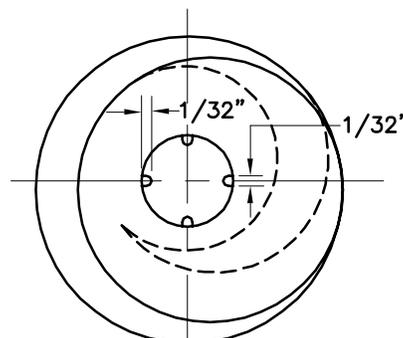

THD. 1-1/2" PER INCH

WORM
(CAST IRON - 1 REQUIRED)



APPROVED:
[Signature]
HEAD, BUREAU OF WATER AND WASTEWATER
[Signature]
DIRECTOR, DEPARTMENT OF PUBLIC WORKS

CITY OF BALTIMORE
DEPARTMENT OF PUBLIC WORKS
BUREAU OF WATER AND WASTEWATER

STANDARD 12" METER COVER -
LOCKING BOLT AND DETAILS

ISSUED	REVISED	REVISED
3 / 2008		

STANDARD NO.
BC 873.01

SCALE: NONE

SHEET 3 OF 3